


**DOCUMENT 00 90 10
ADDENDUM No. 1**

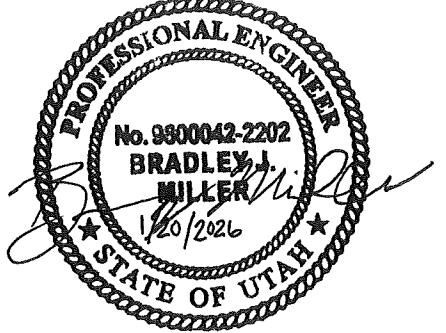

PART 1 GENERAL

1.1 DOCUMENT INCLUDES

- A. Clarifications

1.2 CONSTRUCTION CONTRACT

- A. The Construction Contract is known as *WU015 4275 S Water Main Replacement*
- B. Date of this Addendum: January 20, 2026

PART 2 CHANGES

2.1 CHANGES TO PRIOR ADDENDA

- A. None

2.2 CHANGES TO BIDDING REQUIREMENTS

- A. None

2.3 CHANGES TO AGREEMENT AND OTHER CONTRACT FORMS

- A. None

2.4 CHANGES TO CONDITIONS OF THE CONTRACT

- A. None

2.5 CHANGES TO SPECIFICATIONS

- A. None

2.6 CHANGE TO DRAWINGS

- A. None

2.7 CLARIFICATIONS

- A. Question: What is the depth of Sewer? Answer: The shallowest sewer manhole depth in the project area is 8' and the deepest sewer manhole depth being 10'. The city does not have records of sewer lateral depths. The gathering of lateral and other sewer information is included as part of the pre-camera sewer bid item.

END OF SECTION